





Scale: 2/1

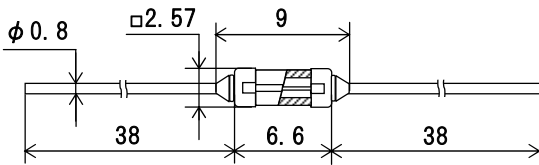

Unit: mm

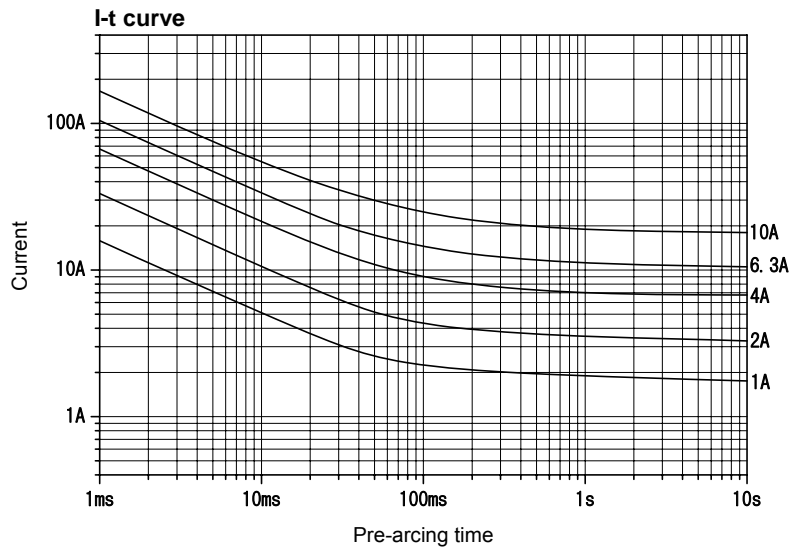

The I-t curves above are based on the average values of measurements obtained under testing conditions specified by our company. The information is for reference purposes only, and is not intended to infer any guarantees of performance.

Rated Voltage	Certification	Range of rated current (I_N)	Rated breaking current		Current carrying capacity $1.0I_N$	Temp. rise	Overload operation
AC250V	C-UL US Listed	50mA - 10A ^{*2}	100A	Resistive circuit	Until temperature stabilization occurs.	75K or less at $1.0I_N$	Within 60s at $2.0I_N$
AC125V	SEMKO Certified	200mA, 250mA, 315mA, 400mA, 500mA, 630mA, 800mA, 1A, 1.25A, 1.6A, 2A, 2.5A, 3.15A, 4A, 5A	50A	PF Over 0.95	4h or more	^{*3}	^{*4}
	<PS>E JET ^{*1}	50mA - 5A ^{*2}					
DC125V	C-UL US Listed	50mA - 10A ^{*2}	300A	Resistive circuit	Until temperature stabilization occurs.	75K or less at $1.0I_N$	Within 60s at $2.0I_N$
	SEMKO Certified	200mA, 250mA, 315mA, 400mA, 500mA, 630mA, 800mA, 1A, 1.25A, 1.6A, 2A, 2.5A, 3.15A, 4A, 5A	50A		4h or more	^{*3}	^{*4}
	<PS>E JET ^{*1}	50mA - 5A ^{*2}					Within 5s at $2.0I_N$

^{*1}: Fuses with rated currents below 1 A are not covered under the Electrical Appliance and Material Safety Law.

^{*2}: Any rated current value can be selected within this range.

^{*3}: 135 K or less on each part of the fuse when $1.0 I_N$ is applied for 15 min, and then the current is increased by $0.1 I_N$ every 15 min until the fuse operates.

Rated current	$2.0I_N$	$2.75I_N$	$4.0I_N$	$10I_N$
200mA - 5A	Within 5s	Within 0.3s	Within 0.03s	Within 0.004s