





Scale: 1/1



Unit: mm

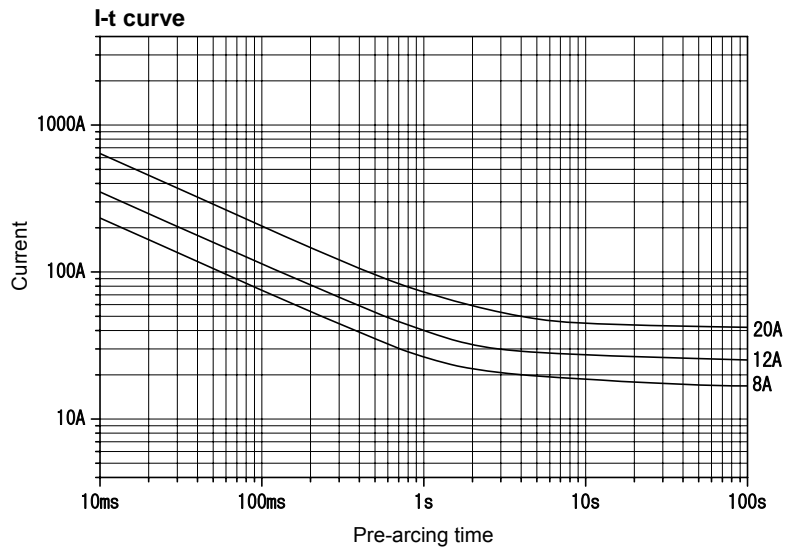

The I-t curves above are based on the average values of measurements obtained under testing conditions specified by our company. The information is for reference purposes only, and is not intended to infer any guarantees of performance.

Rated voltage	Certification	Rated current ( $I_N$ )	Rated breaking current		Test at elevated temp. $1.1 I_N$	Endurance test	Pre-arcing time/ current characteristic
AC250V	SEMKO Certified	8A, 10A, 12A, 15A, 20A	150A	Resistive circuit	Can be passed through the fuse for 1h or more at $70\pm 2^\circ\text{C}$ .	*1	*2
	UL Recognized CSA Component Acceptance						
	<PS>E JET		100A	PF 0.7 - 0.8			

\*1: After repeating 100 cycles of  $1.2 I_N$  for 1 h and switching-off for 15 min,  $1.5 I_N$  can be passed through the fuse for 1 h or more.

\*2:

Rated current	$2.1 I_N$	$2.75 I_N$	$4.0 I_N$	$10 I_N$
8A - 20A	Within 30min	0.6s - 10s	0.15s - 3s	0.02s - 0.3s